


EN 50164-1 IEC 62305 IEC 60364-5-53
IEC 61643-1/GB 18802.1 GB 50057 GB 50343

P IEC






P

T2 40kA

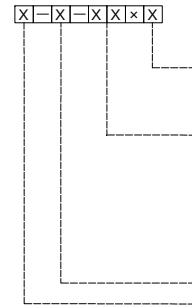

2P TNS
3P TNC IT
P+N TT
3P+N TNS TT
/
24/20 24VDC/20kA
1200/40 1200VDC/40kA
385/40 385VAC/40kA
255/40 255VAC/40kA
385/60 385VAC/60kA
255/60 255VAC/60kA
385/100 385VAC/100kA
260/100 260VAC/100kA
260/25 260VAC/25kA
.....
FL
P:P SPD


P

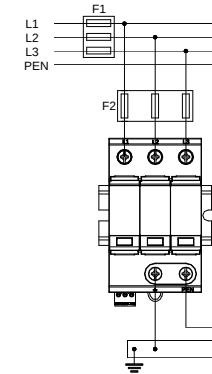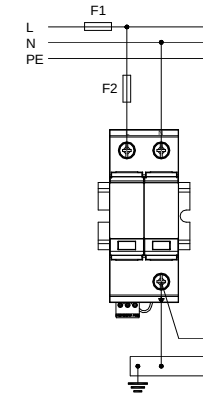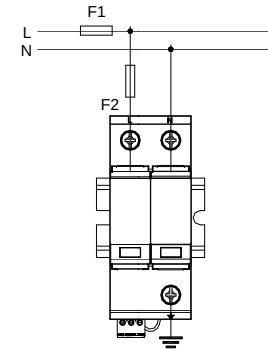

35mm

	/			
Un AC	230/400Vac			
Uc AC	385Vac	385Vac	L-N	255Vac N-PE
8/20 s C2	20kA			
Imax 8/20 s C2	40 kA			
Up(8/20 s C2	≤ 1.8kV	≤ 1.8kV	L-N	≤ 1.5kV N-PE
Up 5kA	≤ 1.3kV			
	≤ 125A gL/gG			
	25kArms			
	≥ 1.5mm ²			
	≤ 25mm ²			
	≤ 25 ns			
	/			
	-40 +80			
	35mm DIN			
	IP 20			
	UL94 V-0			

Nanjing New Power Electric Co., Ltd.

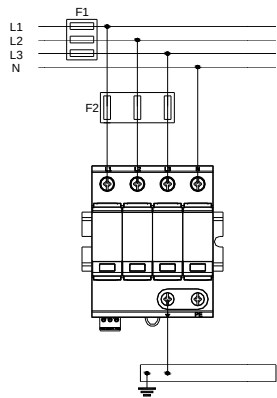


F1 125 A gL

F2=125 A gL/gG I

F2

P

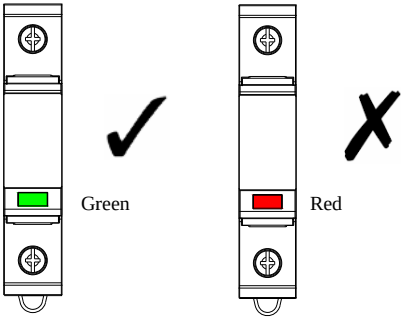

	IF $F1 > 125 \text{ A gL / gG,}$ ↓ $F2 = 125 \text{ A gL / gG}$
	IF $F1 \leq 125 \text{ A gL / gG}$ ↓ F2